COMBINED GARDEN WALL - RETAINING WALL

LEVEL BACKFILL - NO SURCHARGE
WALL AT CENTER OF FOOTING

Revised:	Drawing No:
Approved:	4
Date 5-12-14	Pg 1 of 4

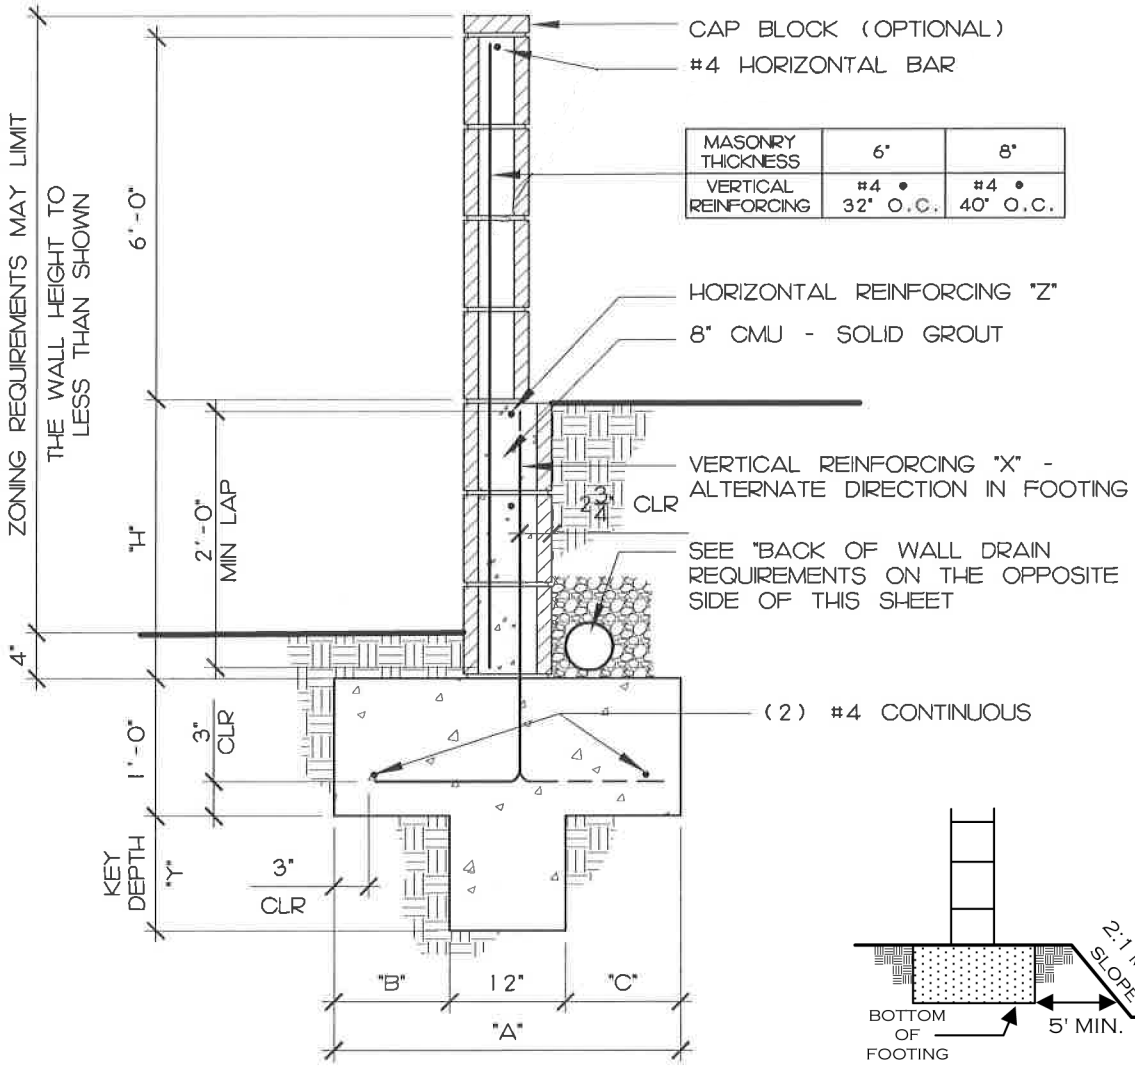

MASONRY THICKNESS	6"	8"
VERTICAL REINFORCING	#4 @ 32" O.C.	#4 @ 40" O.C.

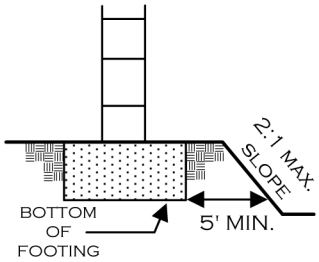

SEE PAGE 7 FOR INSPECTION REQUIRMENTS, CONSTRUCTION REQUIREMENTS, MATERIALS, SPECIFICATIONS AND DETAILS

WALL SCHEDULE

WALL HEIGHT "H"	FOOTING WIDTH "A"	TOE WIDTH "B"	HEEL WIDTH "C"	KEY WIDTH "D"	KEY DEPTH "Y"	VERTICAL REINFORCING "X"	HORIZONTAL REINFORCING "Z"
2'-0"	2'-2"	1'-0"	1'-2"	0"	0"	#4 @ 32" O.C.	1 - #4 TOP
2'-8"	2'-5"	1'-2"	3"	12"	4"	#5 @ 32" O.C.	1 - #4 TOP
3'-4"	2'-9"	1'-3"	6"	12"	6"	#5 @ 32" O.C.	1 - #4 TOP & MID HEIGHT